


TECHNICAL SPECIFICATIONS	ELR-30-M	ELR-30-A	
Earth Leakage Relay	Type A		
SUPPLY			
Supply Voltage	220-415VAC / 220VDC -20% to +20%		
Power Consumption (Max.)	10VA		
LED Indication	Power On	ON (Green Led)	
	EL / CT	ON (Red Led) Relay Trip / Blinking (CT OPEN)	
	Leakage Current/ TST	BY bar graph 30%(Green), 45%(Green), 60%(Yellow), and 75%(Red), Blink Test/Reset Switch is pressed	
Threshold I Δ n (A)	0.03 – 0.1 – 0.3 – 0.5 – 1 – 3 – 5 – 10 – 20 – 30		
Frequency	50-60Hz		
RELAY O / P			
Contact Rating	1 C/O + 1 NO; 5 A (Resistive) @ 240 VAC / 30 VDC		
Contact Arrangement	1 C/O SPDT and 1 NO SPST		
Utilization Category (AC-15)	3.0 A at 120 V & 1.5 A at 240 V		
Utilization Category (DC-13)	0.22 A at 125 V & 0.10 A at 250 V		
Mechanical Life Expectancy	1X10 ⁷		
Electrical Life Expectancy	1X10 ⁵		
Contact Material	Ag Alloy		
RESET			
Reset	Manual Reset	Auto Reset	
No. Of Auto Resets	-	4	
Clear Auto Reset	After 1 hour of healthy condition or supply interruption		
Test / Reset	Local and Remote (Non Potential Free Contacts) (Up to 10 m)		
Δ t Settings (s)	0.040 – 0.06 – 0.15 – 0.25 – 0.5 – 0.8 – 1 – 2.5 – 5 – 10		
Reset Enable	Below 50% of set I Δ n in presence of CBCT		
Reset Time	<1 s		
Type Class	'A' True RMS measurement upto I Δ 1A (as per IEC 60947-2 Annex M)		
Setting Accuracy	'AC' True RMS measurement 30mA to 30A (as per IEC 60947-2 Annex M)		
Repeat Accuracy	- 20% (Including CBCT accuracy)		
AMBIENT			
	\pm 2%		
Storage Temperature	-20°C to + 80°C		
Operating Temperature	-15°C to + 60°C		
Relative Humidity	5 to 95% Rh (without condensation)		
Max. Operating Altitude	2000 m		
Degree of Protection	IP-20 for Terminals, IP-40 for Enclosure		
Operating Position	Any		
Pollution Degree	II		
OTHERS			
Mounting	Din Rail		
Dimensions in mm (W X H X D)	36 X 90 X 65		
Weight Approx. (Un-packed)	150g		
Certification			
CBCT for Type A & AC Current			
	Size (W X H X D) mm	Inner Diameter	I Δ n setting range for Type AC current
CBCT-38	37x91x71	38mm	30mA to 30A
CBCT-70	37x133x109.3	70mm	30mA to 30A
CBCT-92	37x155x132	92mm	30mA to 30A
CBCT-120	37x176x153	120mm	30mA to 30A
CBCT-210	37x282x250	210mm	30mA to 30A
RECTANGULAR CURRENT TRANSFORMER			
Turns Ratio	1500 : 1		
Rated Frequency	50-60Hz		
Leakage Current Range	30mA... 30A		
Rated Operational Current	Up to 2500A		
Operating Temperature	-20°C...+65°C		
Storage Temperature	-20°C...+85°C		
Dimension(mm)	350 x 150x 30mm		
Weight(Kg)	3.7Kg		

ELR & CBCT EARTH LEAKAGE RELAY & CORE BALANCE CURRENT TRANSFORMERS SERIES

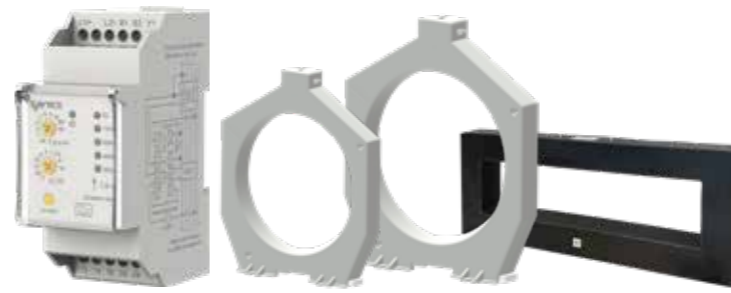

ENTES Quick Start Manual

Trip Characteristics




Standard IEC 60947-2 annex M indicates the operating characteristic for a non-time-delay type in table B.1 in B.4.2.4.1 in standard IEC 60947-2 annex M. CBRs having I Δ n = 30 mA shall be of the non-time-delay type. If the trip time is set at '0' sec, then for 5 I Δ n & 10 I Δ n, the tripping time will be < 40 ms for all current ranges.

Earth Leakage Current	I Δ n	2I Δ n	5I Δ n ¹	10I Δ n ²
Maximum Break Time	0.3	0.15	0.04	0.04
1) For CBRs having I Δ n < 30 mA, 0.25 A may be used as an alternative to 5I Δ n				
2) 0.5 A if 0.25 A is used				



For CBR's having limiting non-actuating time of 0.06 s the operating characteristic is given in table B.2. in B.4.2.4.1 in standard IEC 60947-2 annex M.

Earth Leakage Current	I Δ n	2I Δ n	5I Δ n ¹	10I Δ n ²
Maximum Break Time	0.5	0.2	0.15	0.15

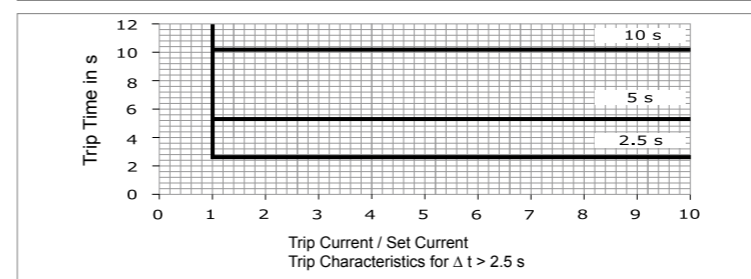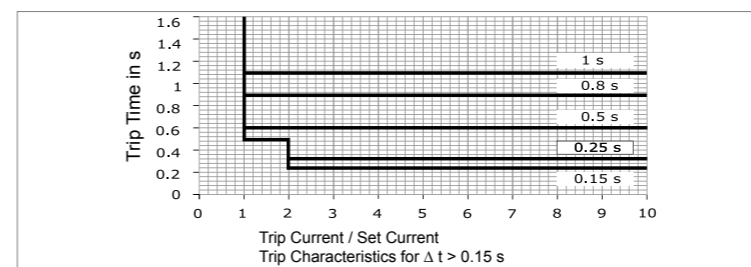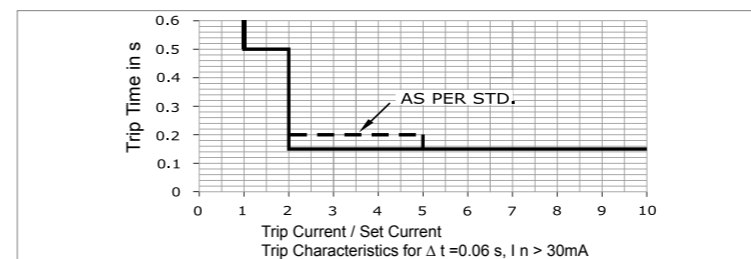

Trip Characteristics for t ≥ 0.15s

EN 60947-2:2003
B.4.2.4.2.2 Operating characteristic for CBR's having a limiting non-actuating time higher than 0.06 s declared by ENTES. The maximum break time at I Δ n, 2 I Δ n, 5 I Δ n, and 10 I Δ n.

Earth Leakage Current Trip setting	Maximum Break Time			
	I Δ n	2I Δ n	5I Δ n ¹	10I Δ n ²
0.15 s	0.5	0.25	0.25	0.25
0.25 s	0.5	0.35	0.35	0.35
0.5 s	0.6	0.6	0.6	0.6
0.8 s	0.9	0.9	0.9	0.9
1 s	1.1	1.1	1.1	1.1
2.5 s	2.6	2.6	2.6	2.6
5 s	5.1	5.1	5.1	5.1
10 s	10.1	10.1	10.1	10.1

Features

- Wide leakage current adjustment range
- Adjustable earth leakage trip time
- Instantaneous trip (for details refer trip characteristics)
- "Test Feature" to check product functionality
- "Manual Reset Feature" with reset button
- Remote resetting
- 1C/O+1NO relay output.
- LED indications for all failures
- Wide auxiliary supply voltage range
- DIN rail mounting
- Easy to install
- Compact size



Recommendations

It is recommended to use CBCT's as mentioned in the table, to ensure the trip current accuracy.

Caution

- Always follow instructions stated in this quick start manual.
- Before installation, ensure that specifications compatible with intended application.
- Installation must be done by a successful electrician.
- Suitable dampers must be provided in case of over-vibration during installation.
- Automation and control devices must be installed so that they are protected against any risk of involuntary actuation.
- Disconnect the power before working on the device.

Terminal Details

	0.54 N.m (4.7Lb.in) Terminal screw - M2.6
	1 x 0.2...3.3 mm ² Solid Wire
AWG	1 x 24 to 12

Use Cu Wire of 60/75°C only

Notes

- Since the innovation of the product is a regular process, we reserve the right to change all its features without prior notice.
- The factory settings of the device are set to 30mA trip and instantaneous delay. These settings can be adjusted as needed by the installation. A seal is supplied allowing the user to secure the clear window and hence prevent any unnecessary adjustment of the settings.
- To comply with regulations, it is recommended that the device should be tested periodically to ensure correct operation.
- In case of excess harmonics power transmission cables have more leakage because of low impedance offered by cable capacitance, I Δ n setting need to keep at higher level.


Functional Description Earth Leakage Protection

- Leakage current is detected through core balance current transformer.
- When earth leakage current exceeds the set value of trip current, for the trip time which is adjustable with the trimpots on the front panel, trip occurs.
- For details refer trip characteristics.
- The Red LED "EL" indicates the presence of Earth Leakage.

CBCT Connections

All main primary conductors shall pass through the core area of CBCT. Use shielded wires for secondary terminal connections to B1 & B2. Connect the shield to the Y2 terminal of device, which is circuit ground of the device. The CT wires should be placed adequately away from high current carrying conductors or source of strong magnetic field to avoid noise pickup. The Earth Leakage Relay also verifies CT connection. If CT winding is open, red LED "EL" blinks.

Functional Diagram

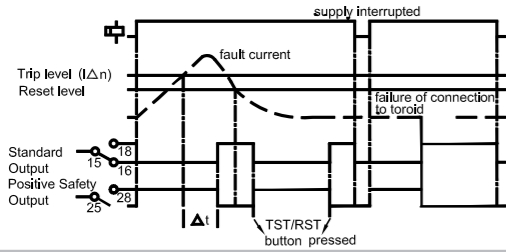

Test / Reset

Press & hold "tst/rst switch" for 1sec. The product will change its state from "healthy" to "Trip (Test)" and vice versa "Reset".

Remote Test / Reset


For "remote testing & resetting", connect an external push button/switch between Y1 and Y2. For test sequence, press and hold the external push button switch for 1sec.

Auto/ Reset


For the ELR-30-A, product will automatically reset itself after 4 earth leakage fault in 15min. Reset count is cleared after 1 hour of healthy condition, supply interruption or pressing of the test /reset switch.

Overall Dimensions and Mounting Details


ELR

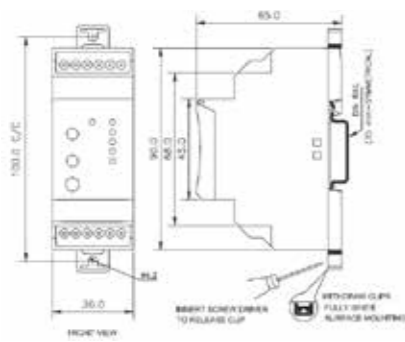

CBCT

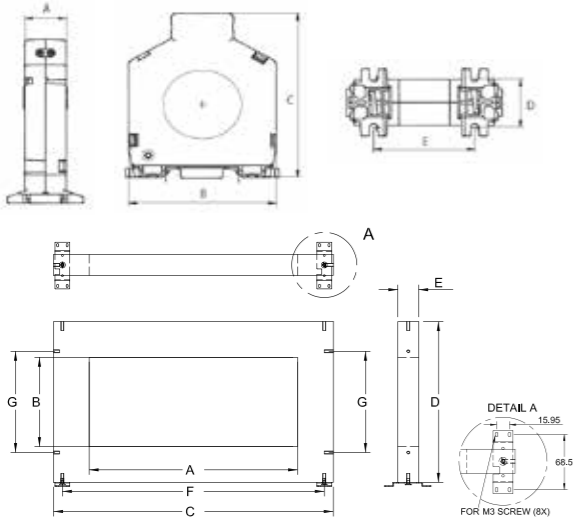

Front Face

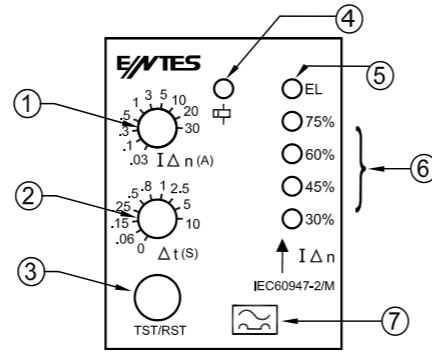


- Trimpot for "earth leakage current" setting
- Trimpot for "trip time" setting
- "Test/ Reset Function" button
- "Power ON" LED indication
- "Earth leakage fault" or "CT open" LED indication
- Bar graph for "earth leakage fault" indication
- "Type A" symbol

Notes

- For CT connections use shielded wire and connect shield to Y2 terminal.
- For single phase applications, only phase and neutral cables need to be passed through CBCT.
- Do not pass ground conductor through CBCT connected to earth leakage relay.
- All conductors to be protected must pass through CBCT.
- Do not apply supply voltage at CT and switch terminal.
- Connect the wires between CBCT and ELR with respect to B1 & B2. Wire gauge should be as mentioned under "Terminal Details".
- This device satisfies the requirements for Type A devices which provides protection against leakage current in systems where alternating and direct current are used together.

ELR Operating condition	Contact Position	
	1 NO (PSO/Fail Safe)	1 CO (PSO/Fail Safe)
No Auxiliary		
Healthy / Rest State		
Trip State		


Centre the cables within the toroid

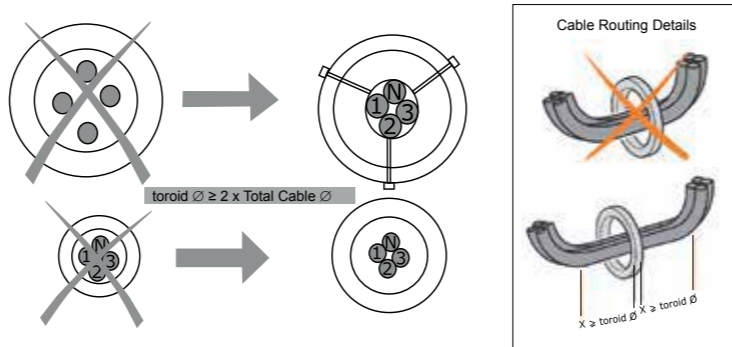

RATIO A/A	DIMENSIONS (mm)						Weight
	C	DE	F/GA	B			
1500/1	445	240	30	405/200	350	150	3,7 KG

CBCT	Diameter (mm)	WEIGHT (gr)	A	B	C	D	E
CBCT-38	38	110	20	71	91	27	48
CBCT-70	70	240	20	109	133	27	60
CBCT-92	92	250	20	132	155	27	73
CBCT-120	120	255	20	153	176	27	73
CBCT-210	210	280	20.5	250	282	28	128

Connection Diagram

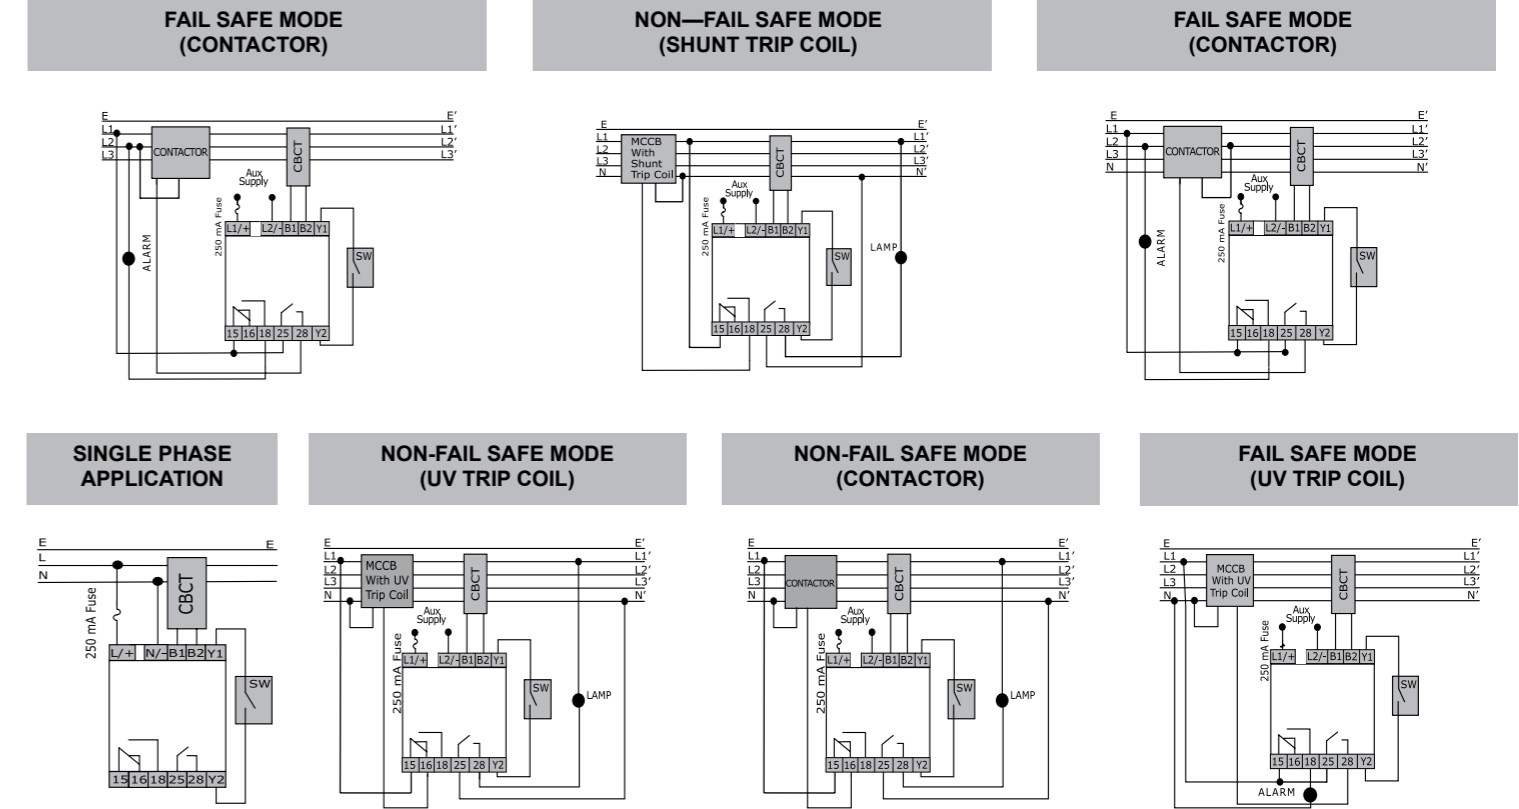

Conformity to Standards EMC

Harmonic Current Emission	IEC 61000-3-2	Class A
Voltage Flicker and Fluctuations	IEC 61000-3-3	Class A
ESD	IEC 61000-4-2	Level II
Radiated Susceptibility	IEC 61000-4-3	Level III "Criteria B"
Electrical Fast Transients	IEC 61000-4-4	Level IV
Surge	IEC 61000-4-5	Level IV for AC & Level I for DC Products
Conducted Susceptibility	IEC 61000-4-6	Level III for AC
Voltage Dips and Interruptions (AC)	IEC 61000-4-11	Level I, II, III, IV, V, VI & VIII
Voltage Dips and Interruptions (DC)	50% for 50mSec @ Nominal Voltage 15V DC	
Conducted Emission	CISPR 11	Class A
Raiated Emission	CISPR 11	Class A

Security

Test Voltage Between I / P & O/P	IEC 60947-5-1 / UL 508	2 kV
Test Voltage Between all Terminals & Enclosure	IEC 60947-5-1 / UL 508	2.5 kV
Over Voltage Category	IEC 60947-1	IV
Impulse Voltage Between I/P & O/P	IEC 60947-5-1	Level 4kV
Single Fault	IEC 61010-1	
Insulation Resistance	UL 508	>50kOhm
Leakage Current	UL 508	<3.5 mA

Environmental


Cold Heat	IEC 60068-2-1	
Dry heat	IEC 60068-2-2	
Vibration	IEC 60068-2-6	5g(10-50 Hz)
Repetitive Shock	IEC 60068-2-27	40 g, 6 ms
Non-repetitive Shock	IEC 60068-2-27	30 g, 15 ms

Note: As per IEC60947-2 (B.4.2.2) The minimum value of rated residual non operating current is 0.5 IΔn.



TEKNİK ÖZELLİKLER	ELR-30-M	ELR-30-A	
Kaçak Akım Rölesi Tipi	A Tipi		
BESLEME ÖZELLİKLERİ			
Besleme Gerilimi	220-415VAC / 220VDC -20% to +20%		
Güç Tüketimi (Maks.)	10VA		
LED Göstergesi	Güç AÇIK	Cihaz AÇIK (Yeşil LED)	
	EL / CT	Cihaz AÇIK(Kırmızı LED) Röle Açma / Yanıp Sönme (CT AÇIK)	
	Kaçak Akım / TST	Çubuk grafiğine göre %30(Yeşil), %45(Yeşil), %60(Sarı) ve %75(Kırmızı), Yanıp Sönme Testi / Sıfırlama Butonuna Basılı olduğunda	
Eşik değeri IΔn (A)	0.03 – 0.1 – 0.3 – 0.5 – 1 – 3 – 5 – 10 – 20 – 30		
Frekans	50-60Hz		
RÖLE O / P ÖZELLİKLERİ			
Kontakt Çıkışı	1 C/O + 1 NO; 5 A (Rezistif) @ 240 VAC / 30 VDC		
Kontakt Ayarı	1 C/O SPDT ve 1 NO SPST		
Kullanım Kategorisi (AC-15)	120V'da 3.0A & 240V'da 1.5A		
Kullanım Kategorisi (DC-13)	125V'da 0.22A & 250V'da 0.10A		
Beklenen Mekanik Ömür	1X10 ⁷		
Beklenen Elektriksel Ömür	1X10 ⁵		
Kontakt Malzemesi	Ag (Gümüş) Alaşımı		
RESET ÖZELLİKLERİ			
Reset	Manuel Reset	Otomatik Reset	
Otomatik Reset Sayısı	-	4	
Otomatik Reset Temizle	1 saatlik sabit güçten veya besleme kesintisinden sonra		
Test / Reset	Cihaz üzerinden ve uzaktan sıfırlama		
Δt Ayarları (s)	0.040 – 0.06 – 0.15 – 0.25 – 0.5 – 0.8 – 1 – 2.5 – 5 – 10		
Resetlemeyi Etkinleştir	CBTC ile birlikte IΔn setinin %50'sinin altında		
Resetleme Süresi	<1 sn		
Reset	IΔn'a kadar "A" Doğru RMS ölçümü (IEC 60947-2 Annex M 'a uygun olarak) 30mA-30A "AC" Doğru RMS ölçümü(IEC 60947-2 Annex M'a uygun olarak)		
Ayar Doğruluğu	- 20% (CBCT doğruluğu dahil)		
Tekrarlama Doğruluğu	± 2%		
ÇEVRE KOŞULLARI			
Depolama Sıcaklığı	-20°C ... + 80°C		
Çalışma Sıcaklığı	-15°C ... + 60°C		
Bağıl Nemlilik	5 ... 95% Rh (Yoğuşma olmadan)		
Maksimum Çalışma Yüksekliği	2000 m		
Koruma Sınıfı	Klemensler için IP20, Dış Kutu için IP40		
Çalışma Pozisyonu	Hiç		
Kirlilik Derecesi	II		
DİĞER			
Montaj	DIN Raya		
Boyutlar(mm)	36 X 90 X 65		
Yaklaşık Ağırlık. (paketlenmemiş)	150g		
Sertifikalar	CE RoHS		
A TİPİ VE AC AKIM İÇİN CBCT			
	Boyut (G x Y x D) mm	İç Çap	Tip AC akımı için IΔn ayar aralığı
CBCT-38	37x91x71	38mm	30mA to 30A
CBCT-70	37x133x109.3	70mm	30mA - 30A
CBCT-92	37x155x132	92mm	30mA - 30A
CBCT-120	37x176x153	120mm	30mA - 30A
CBCT-210	37x282x250	210mm	30mA - 30A
CBCT-R-350 DİKDÖRTGEN AKIM TRAFOSU			
Dönüş Oranı	1 : 1500		
Frekans	50-60Hz		
Kaçak Akım Aralığı	30mA... 30A		
Nominal İşletme Akımı	2500A'ye kadar		
Çalışma Sıcaklığı	-20°C...+65°C		
Depolama Sıcaklığı	-20°C...+85°C		
Boyutlar(mm)	350 x 150x 30mm		
Ağırlık(Kg)	3.7Kg		

ELR & CBCT TOPRAK KAÇAK AKIM RÖLESİ & TOROİD AKIM TRAFOSU SERİSİ

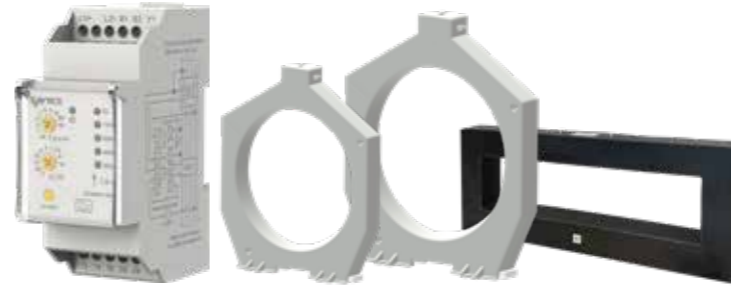


EWTES Hızlı Kurulum Talimatı

Açma Özellikleri




Standart IEC 60947-2 annex M", standart IEC 0947-2 annex M'deki B.4.2.4.1'deki tablo B.1'de zaman gecikmesiz tip için çalışma karakteristiğini gösterir. IΔn=30mA değerine sahip CBR'ler gecikmesiz tipte olacaktır. Açma süresi '0' saniye olarak ayarlanırsa, 5 IΔn & 10 IΔn için, açma süresi tüm mevcut aralıklar için <40 ms olacaktır.

Kaçak Akım	IΔn	2IΔn	5IΔn ¹	10IΔn ²
Maksimum Kesme Süresi	0.3	0.15	0.04	0.04
1) IΔn < 30 mA olan CBR'ler için 5IΔn'ye alternatif olarak 0,25A kullanılabilir.				
2) 0.25A 1.maddeye göre kullanılırsa 0.5A				

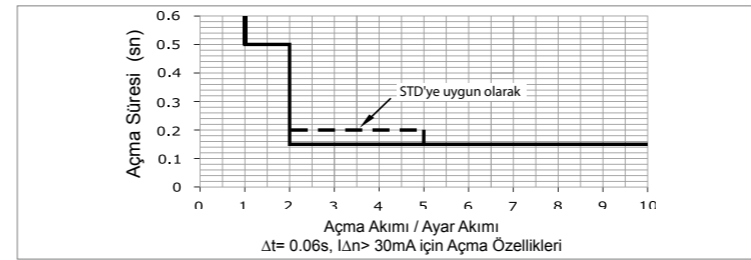

0,06 sn'lik çalıştırmama süresini sınırlayan CBR'ler için çalışma özellikleri, IEC 60947-2 annex M standardı B.4.2.4.1'deki tablo B.2'de verilmiştir.

Kaçak Akım	IΔn	2IΔn	5IΔn ¹	10IΔn ²
Maksimum Kesme Süresi (sn)	0.5	0.2	0.15	0.15

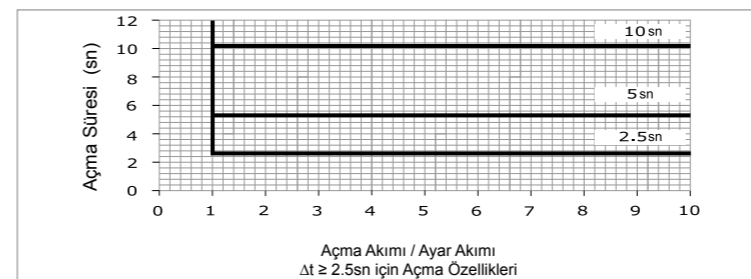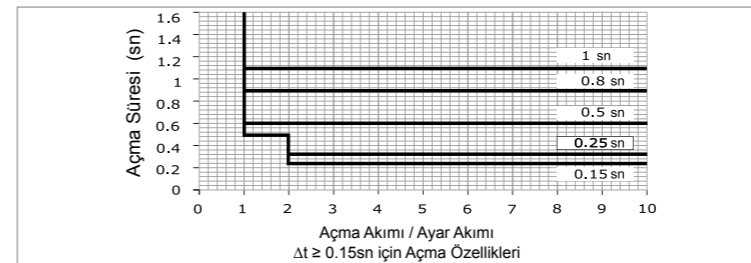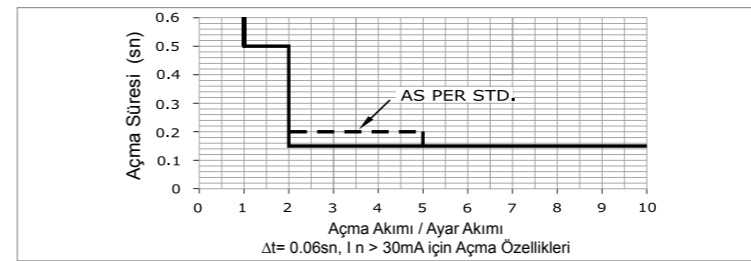

t ≥ 0.15s için Açma Özellikleri

EN 60947-2:2003
0,06sn'den daha yüksek bir çalıştırma dışı sınırlama süresine sahip CBR'ler için çalışma karakteristiği B.4.2.4.2' tarafından beyan edilmiştir. IΔn, 2 IΔn, 5IΔn ve 10 IΔn 'de maksimum kesme süreleri aşağıdaki tabloda gösterilmiştir.

Kaçak Akım Açma Ayarı	Maksimum Kesme Süresi (sn)			
	IΔn	2IΔn	5IΔn ¹	10IΔn ²
0.15 sn	0.5	0.25	0.25	0.25
0.25 sn	0.5	0.35	0.35	0.35
0.5 sn	0.6	0.6	0.6	0.6
0.8 sn	0.9	0.9	0.9	0.9
1 sn	1.1	1.1	1.1	1.1
2.5 sn	2.6	2.6	2.6	2.6
5 sn	5.1	5.1	5.1	5.1
10 sn	10.1	10.1	10.1	10.1

Özellikler

- Geniş kaçak akım ayarı aralığı
- Ayarlanabilir kaçak akım açma süresi
- Anlık açma (ayrıntılar için açma özelliklerine bakın)
- Cihazın düzgün çalışıp çalışmadığını kontrol etmek için "Test Özelliği"
- Cihaz üzerindeki reset anahtarını aracılığı ile "Manuel Reset Özelliği"
- Uzaktan reset özelliği
- 1C/O+1NO Röle Çıkışı
- Tüm hata durumları için LED göstergeleri
- Geniş yardımcı besleme voltaj aralığı
- DIN raya montaj
- Kolay kurulum
- Kompakt boyut



Öneriler

Açma akımı doğruluğunu sağlamak için tabloda belirtildiği gibi CBCT'lerin kullanılması önerilir.

⚠ Dikkat

- Her zaman bu kullanma talimatında belirtilen maddelere uyun.
- Kurulumdan önce, teknik özelliklerin amaçlanan uygulamayla uyumlu olduğundan emin olun.
- Kurulum yetenekli bir elektrik teknisyeni tarafından yapılmalıdır.
- Montaj sırasında aşırı titreşim olması durumunda uygun damperler sağlanmalıdır.
- Otomasyon ve kontrol cihazları, herhangi bir istem dışı çalışma riskine karşı korunacak şekilde kurulmalıdır.
- Cihaz ve ekipmanlar üzerinde çalışmadan önce gücü kesin.

Klemens Detayları

 Ø3.5 mm	0.54 N.m (4.7Lb.in) Klemens vidası - M2.6
	1 x 0.2...3.3 mm ² Tek Damarlı Kablo
AWG	1 x 24 to 12

Yalnızca 60/75°C Cu(Bakır) Teli kullanın

Notlar

- Ürünün yenilenmesi düzenli bir süreç olduğundan, tüm özelliklerini önceden haber vermeksizin değiştirme hakkımızı saklı tutuyoruz.
- Cihazın fabrika ayarları 30mA açma ve anlık gecikme olarak ayarlanmıştır. Bu ayarlar kurulumun gerektirdiği şekilde ayarlanabilir. Kullanıcının şeffaf pencereyi emniyete almasına ve dolayısıyla ayarların gereksiz şekilde değiştirilmesini engellemesine olanak tanıyan bir conta birlikte verilmektedir.
- Yönetmeliklere uymak amacıyla, cihazın doğru çalışmasını sağlamak amacıyla periyodik olarak test edilmesi önerilir.
- Aşırı harmonik olması durumunda, kablo kapasitesinin sunduğu düşük empedans nedeniyle güç iletim kablolarında daha fazla kaçak olması durumunda, IΔn ayarının daha yüksek seviyede tutulması gerekir.


Fonksiyonel Açıklama Kaçak Akım Koruma

- Toroid akım trafosu aracılığıyla kaçak akım tespit edilir.
- Ön paneldeki trimpotlar ile ayarlanabilen açma süresi boyunca toprak kaçak akımı, ayarlanan açma akım değerini aştığında açma meydana gelir.
- Ayrıntılar için açma özelliklerine bakın.
- Kırmızı LED "EL" Toprak Kaçağının varlığını gösterir.

CBCT Bağlantıları

Tüm ana birincil iletkenler CBCT'nin çekirdek alanından geçecektir. B1 ve B2'ye ikincil terminal bağlantıları için korumalı kablolar kullanın. Korumayı cihazın devre toprağı olan cihazın Y2 terminaline bağlayın. CT kabloları, gürültü alımını önlemek için yüksek akım taşıyan iletkenlerden veya güçlü manyetik alan kaynağından yeterince uzağa yerleştirilmelidir. Toprak Kaçak Rölesi ayrıca CT bağlantısını da doğrular. CT sargısı açıkta kırmızı LED "EL" yanıp sönür.

Fonksiyonel Şema

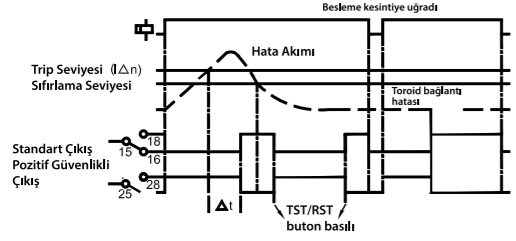

Test / Reset

Kontak anahtarına 1sn basılı tutulması halinde cihazı sağlıklı çalışma durumundan "Açma(test)" durumuna ya da tam tersi olacak duruma geçer.

Uzaktan Test/ Reset


Uzaktan test/reset fonksiyonunu aktifleştirmek için harici basmalı düğme anahtarını/ butonu Y1 ve Y2'ye bağlayın. Test/reset için harici basmalı anahtar 1 sn basılı tutun.

Otomatik / Reset


ELR-30-A modeli için, cihaz yalnızca 4 kere için 15 dakika sonra resetlenir. Reset sayısı, 1 saatlik normal çalışma durumunda, besleme kesintisinden veya test / reset anahtarına basıldıktan sonra temizlenir.

Genel Boyutlar ve Montaj Detayları


ELR

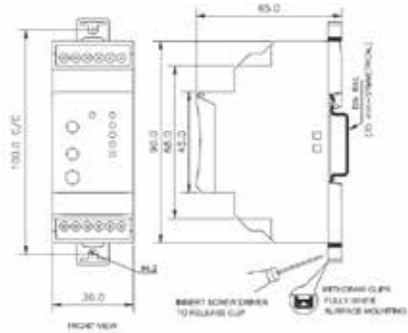

CBCT

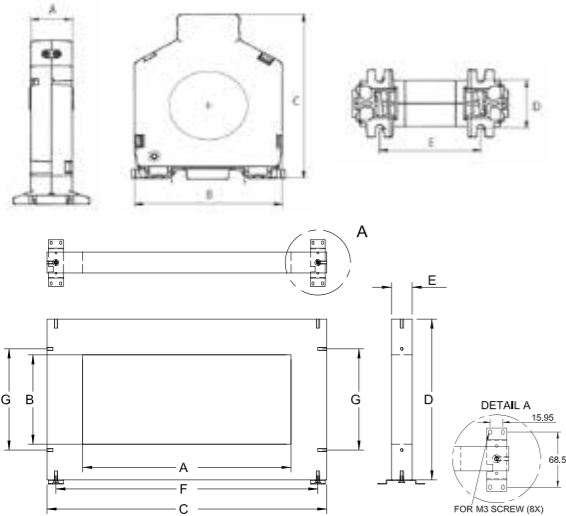

Ön Yüz

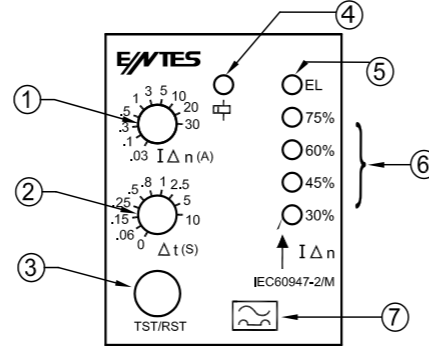


1. Kaçak akım ayarı için trimpot
2. "Açma süresi ayarı" için trimpot
3. Test/Reset fonksiyon butonu
4. Güç AÇIK LED Göstergesi
5. Kaçak Akım hatası LED göstergesi / CT açık
6. Kaçak akım hatası için çubuk grafik
7. A Tipi kaçak akım rölesi sembolü

Not

1. CT Bağlantıları için blendajlı kablo kullanın ve blendajı Klemens Y2'ye bağlayın.
2. Tek fazlı uygulamalar için CBCT'den sadece faz ve nötr geçmelidir.
3. Kaçak Akım Rölesine bağlı CBCT'den toprak iletkeni geçirmeyin. Korunacak tüm iletkenler CBCT'den geçmelidir.
5. CT'ye ve anahtar klemensine besleme gerilimi uygulamayın.
6. CBCT ve ELR arasındaki kabloları B1 ve B2'ye göre bağlayın. Kablo ölçüsü "Klemens Detayları" bölümünde belirtildiği gibi olmalıdır.
7. Bu cihaz, alternatif ve doğru akımın birlikte kullanıldığı sistemlerde kaçak akıma karşı koruma sağlayan A Tipi cihazlara yönelik gereklilikleri karşılamaktadır.

ELR Çalışma Durumu	Kontak Pozisyonları	
	1 NO (PSO/Fail Safe)	1 CO (PSO/Fail Safe)
Yardımcı Besleme Yok		
Normal Çalışma/ Sıfırlama Durumu		
Açma Durumu		


Kabloları toroid içinde ortalayın

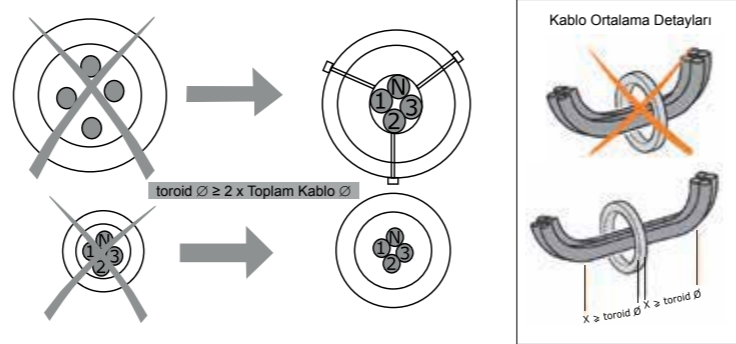

RATIO A/A	BOYUTLAR (mm)						Ağırlık
	C	DE		F/GA	B		
1500/1	445	240	30	405/200	350	150	3,7 KG

CBCT	ÇAP (mm)	AĞIRLIK (gr)	A	B	C	D	E
CBCT-38	38	110	20	71	91	27	48
CBCT-70	70	240	20	109	133	27	60
CBCT-92	92	250	20	132	155	27	73
CBCT-120	120	255	20	153	176	27	73
CBCT-210	210	280	20.5	250	282	28	128

Bağlantı Şemaları

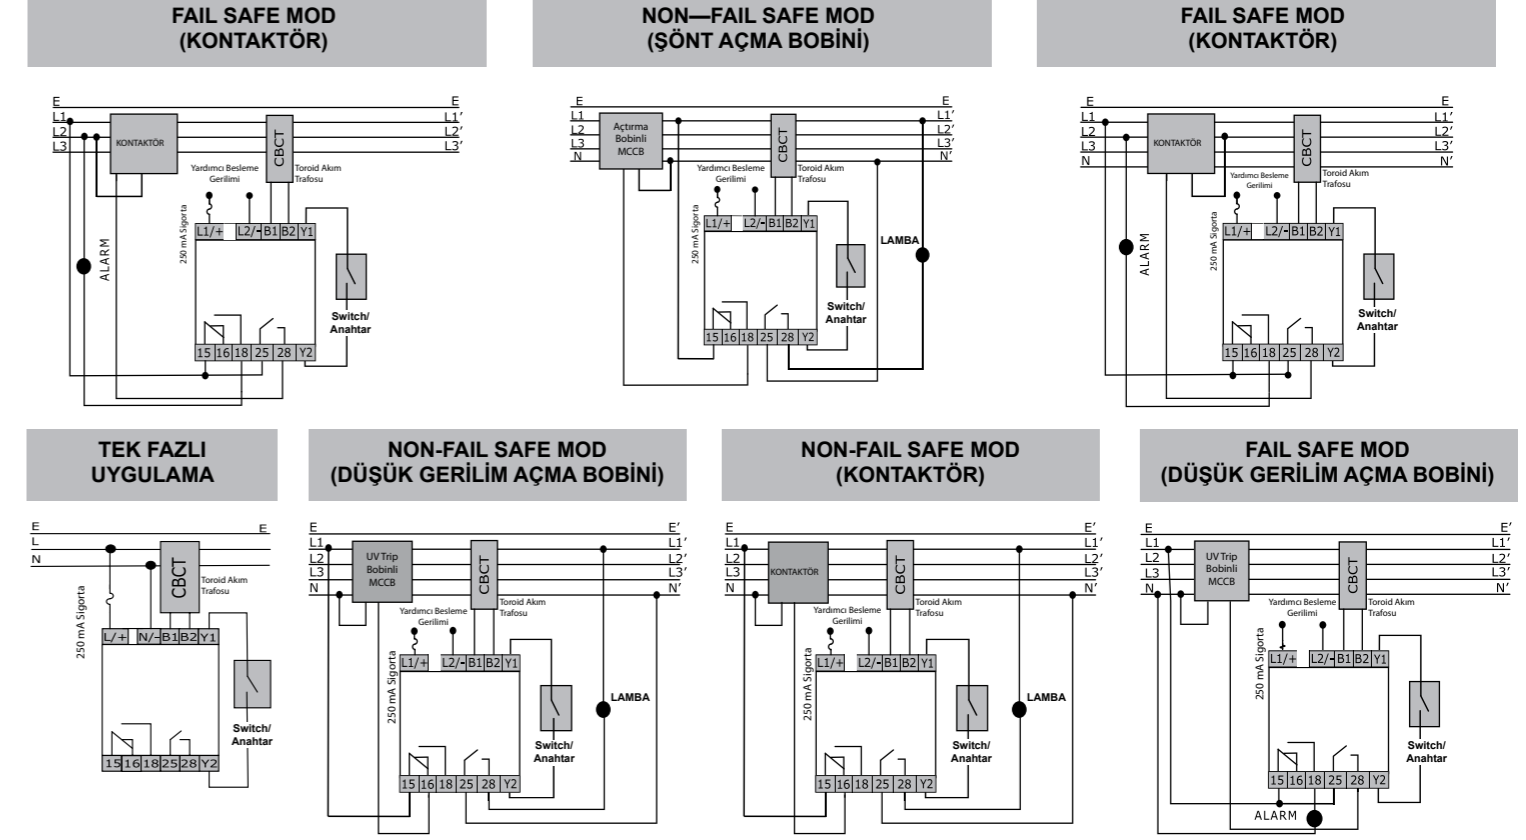

Standartlar

Harmonik Akım Emisyonları	IEC 61000-3-2	A Sınıfı
Gerilim Titreşimi ve Dalgalanmalar	IEC 61000-3-3	A Sınıfı
ESD	IEC 61000-4-2	Level II
Radyasyon Duyarlılığı	IEC 61000-4-3	Level III
Elektriksel Hızlı Geçişler	IEC 61000-4-4	Level IV
Dalgalanma	IEC 61000-4-5	Level IV AC için & Level I DC Cihazlar için
Yürütülen Duyarlılık	IEC 61000-4-6	Level III AC için
Gerilim Düşmeleri ve Kesintiler(AC)	IEC 61000-4-11	Level I, II, III, IV, V, VI & VIII
Gerilim Düşmeleri ve Kesintiler(DC)	50% for 50mSec @ Anma Gerilimi 15V DC	
İletilen Emisyon	CISPR 11	A Sınıfı
Yayılan Emisyon	CISPR 11	A Sınıfı

Güvenlik

I/P & O/P arasında Test Gerilimi	IEC 60947-5-1 / UL 508	2 kV
Tüm Klemensler ve Kutu Arasındaki Test Gerilimi	IEC 60947-5-1 / UL 508	2.5 kV
Aşırı Gerilim Kategorisi	IEC 60947-1	IV
I/P & O/P arasındaki impuls voltajı	IEC 60947-5-1	Level 4kV
Tek Hata	IEC 61010-1	
Yalıtım direnci	UL 508	>50KOhm
Kaçak Akım	UL 508	<3.5 mA

Çevresel

Soğuk Isı	IEC 60068-2-1	
Kuru Isı	IEC 60068-2-2	
Titreşim	IEC 60068-2-6	5g(10-50 Hz)
Tekrarlanan Şok	IEC 60068-2-27	40 g, 6 ms
Tekrarlanmayan Şok	IEC 60068-2-27	30 g, 15 ms

Not: IEC60947-2'ye göre (B.4.2.2) Nominal çalışmama kaçak akımının minimum değeri 0,5 IΔn'dir.

